


TO DTMF PHONES (5 MAX)

NOTE:  
ENSURE THAT THE CORRECT DIP SWITCHES ARE SET AND THAT THE IT/200 IS PROGRAMMED AS PER ITS MANUAL. (IE. 29-0 & 63-1)  
ENSURE THAT THE BT LINE 'IN' IS AN ANALOGUE LINE NOT ISDN.

NOTE:  
ALL CONTROL EQUIPMENT MUST BE CENTRALLY LOCATED.

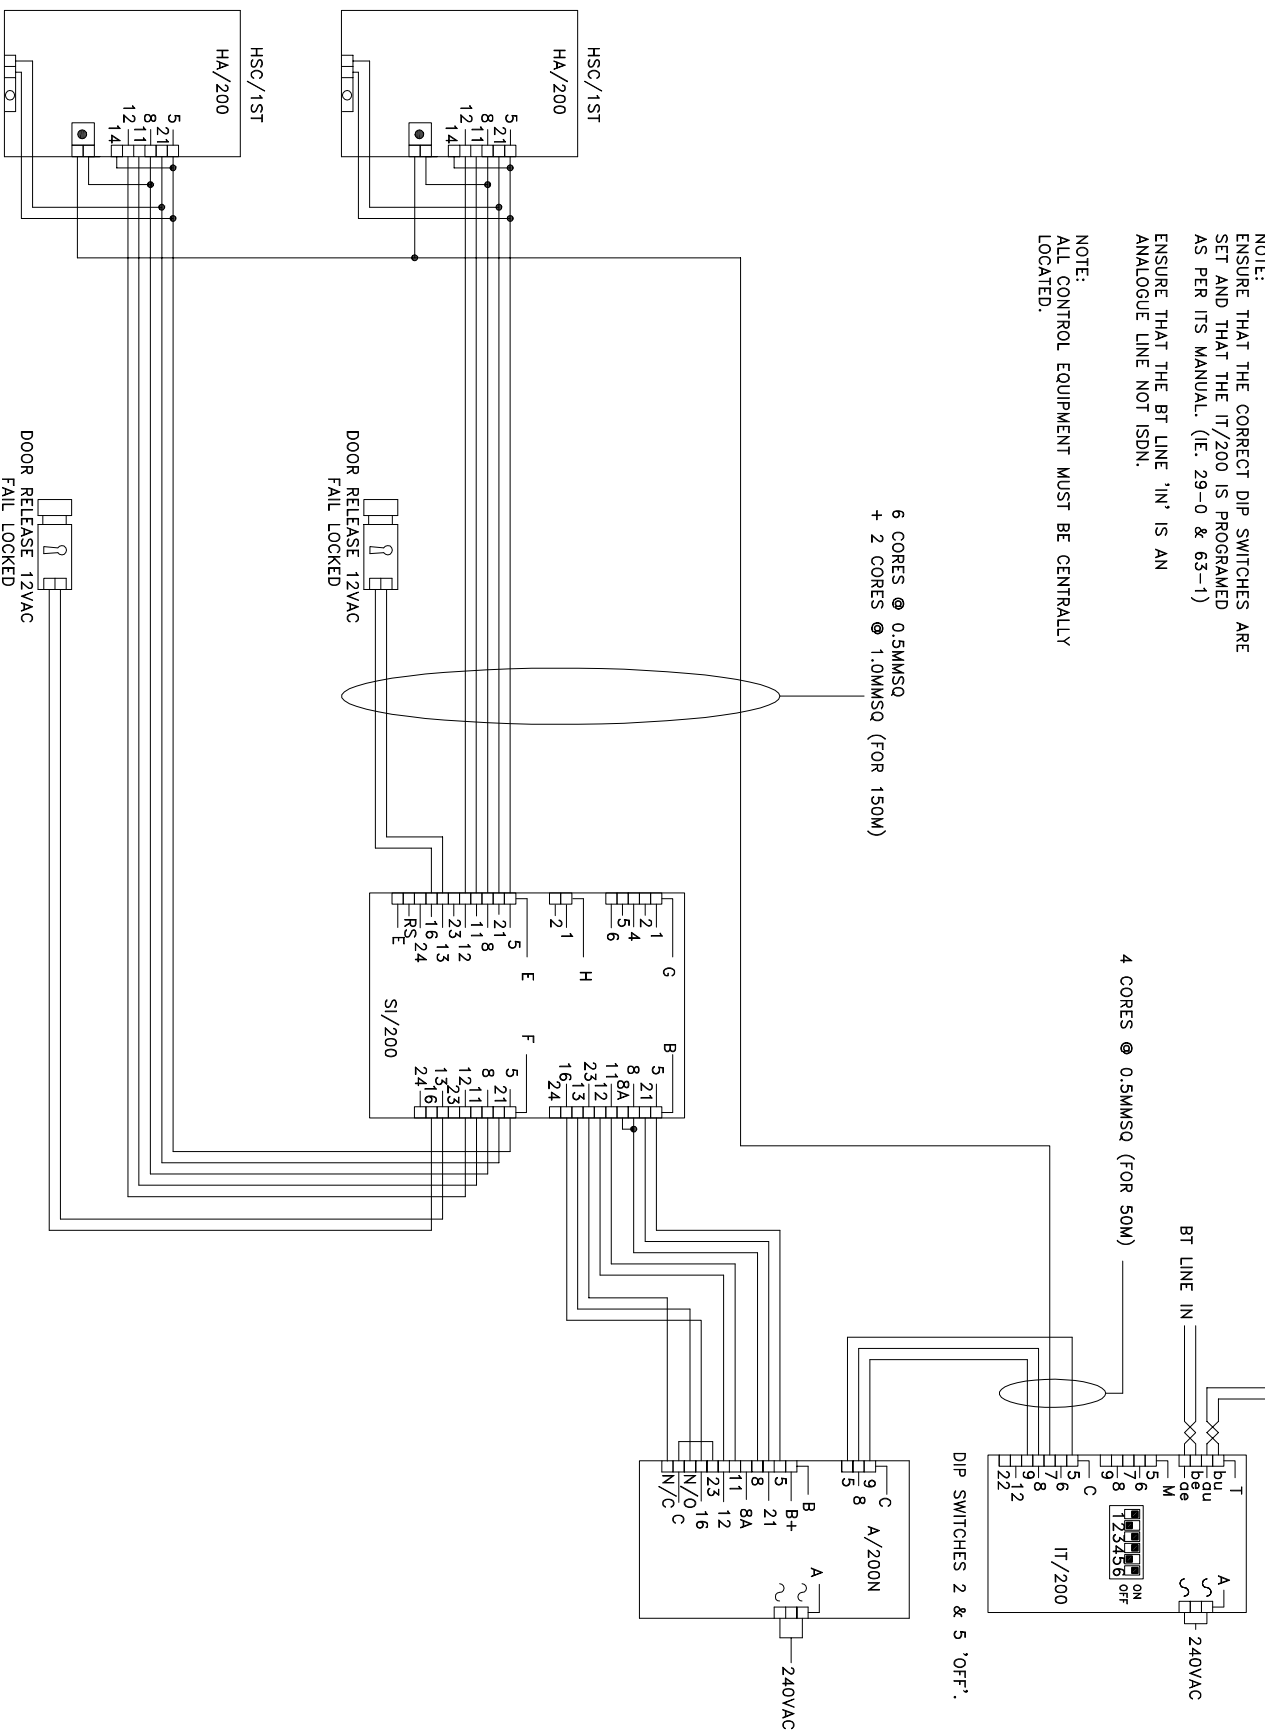

BPT (UK) LTD. HERTS. ENGLAND		PREPARED FOR INSTALLER INFORMATION	
DRAWING TITLE: 2 X 1 TARGHA AUDIO ENTRY PANEL & 1 BT TELEPHONE INTERFACE		DATE: 17/07/08	DRAWN:RC
		REVISED:	
		DRAWING No: E-1T211(L(A)	