


NOTE:
THIS DRAWING INDICATES AND ASSUMES THE USE OF
BPT COMPOSITE CABLES OR A SUITABLE EQUIVALENT.
ENSURE ALL ADDITIONAL CONNECTIONS ARE
A MINIMUM OF 0.5MM CSA PER CORE.

NOTE: CABLE EQUIVALENTS

VCM/130 = RG59 COAX + 4 CORES @ 1.0MMSQ + 8 CORES @ 0.5MMSQ
VCM/60 = RG59 COAX + 2 CORES @ 1.0MMSQ + 3 CORES @ 0.5MMSQ

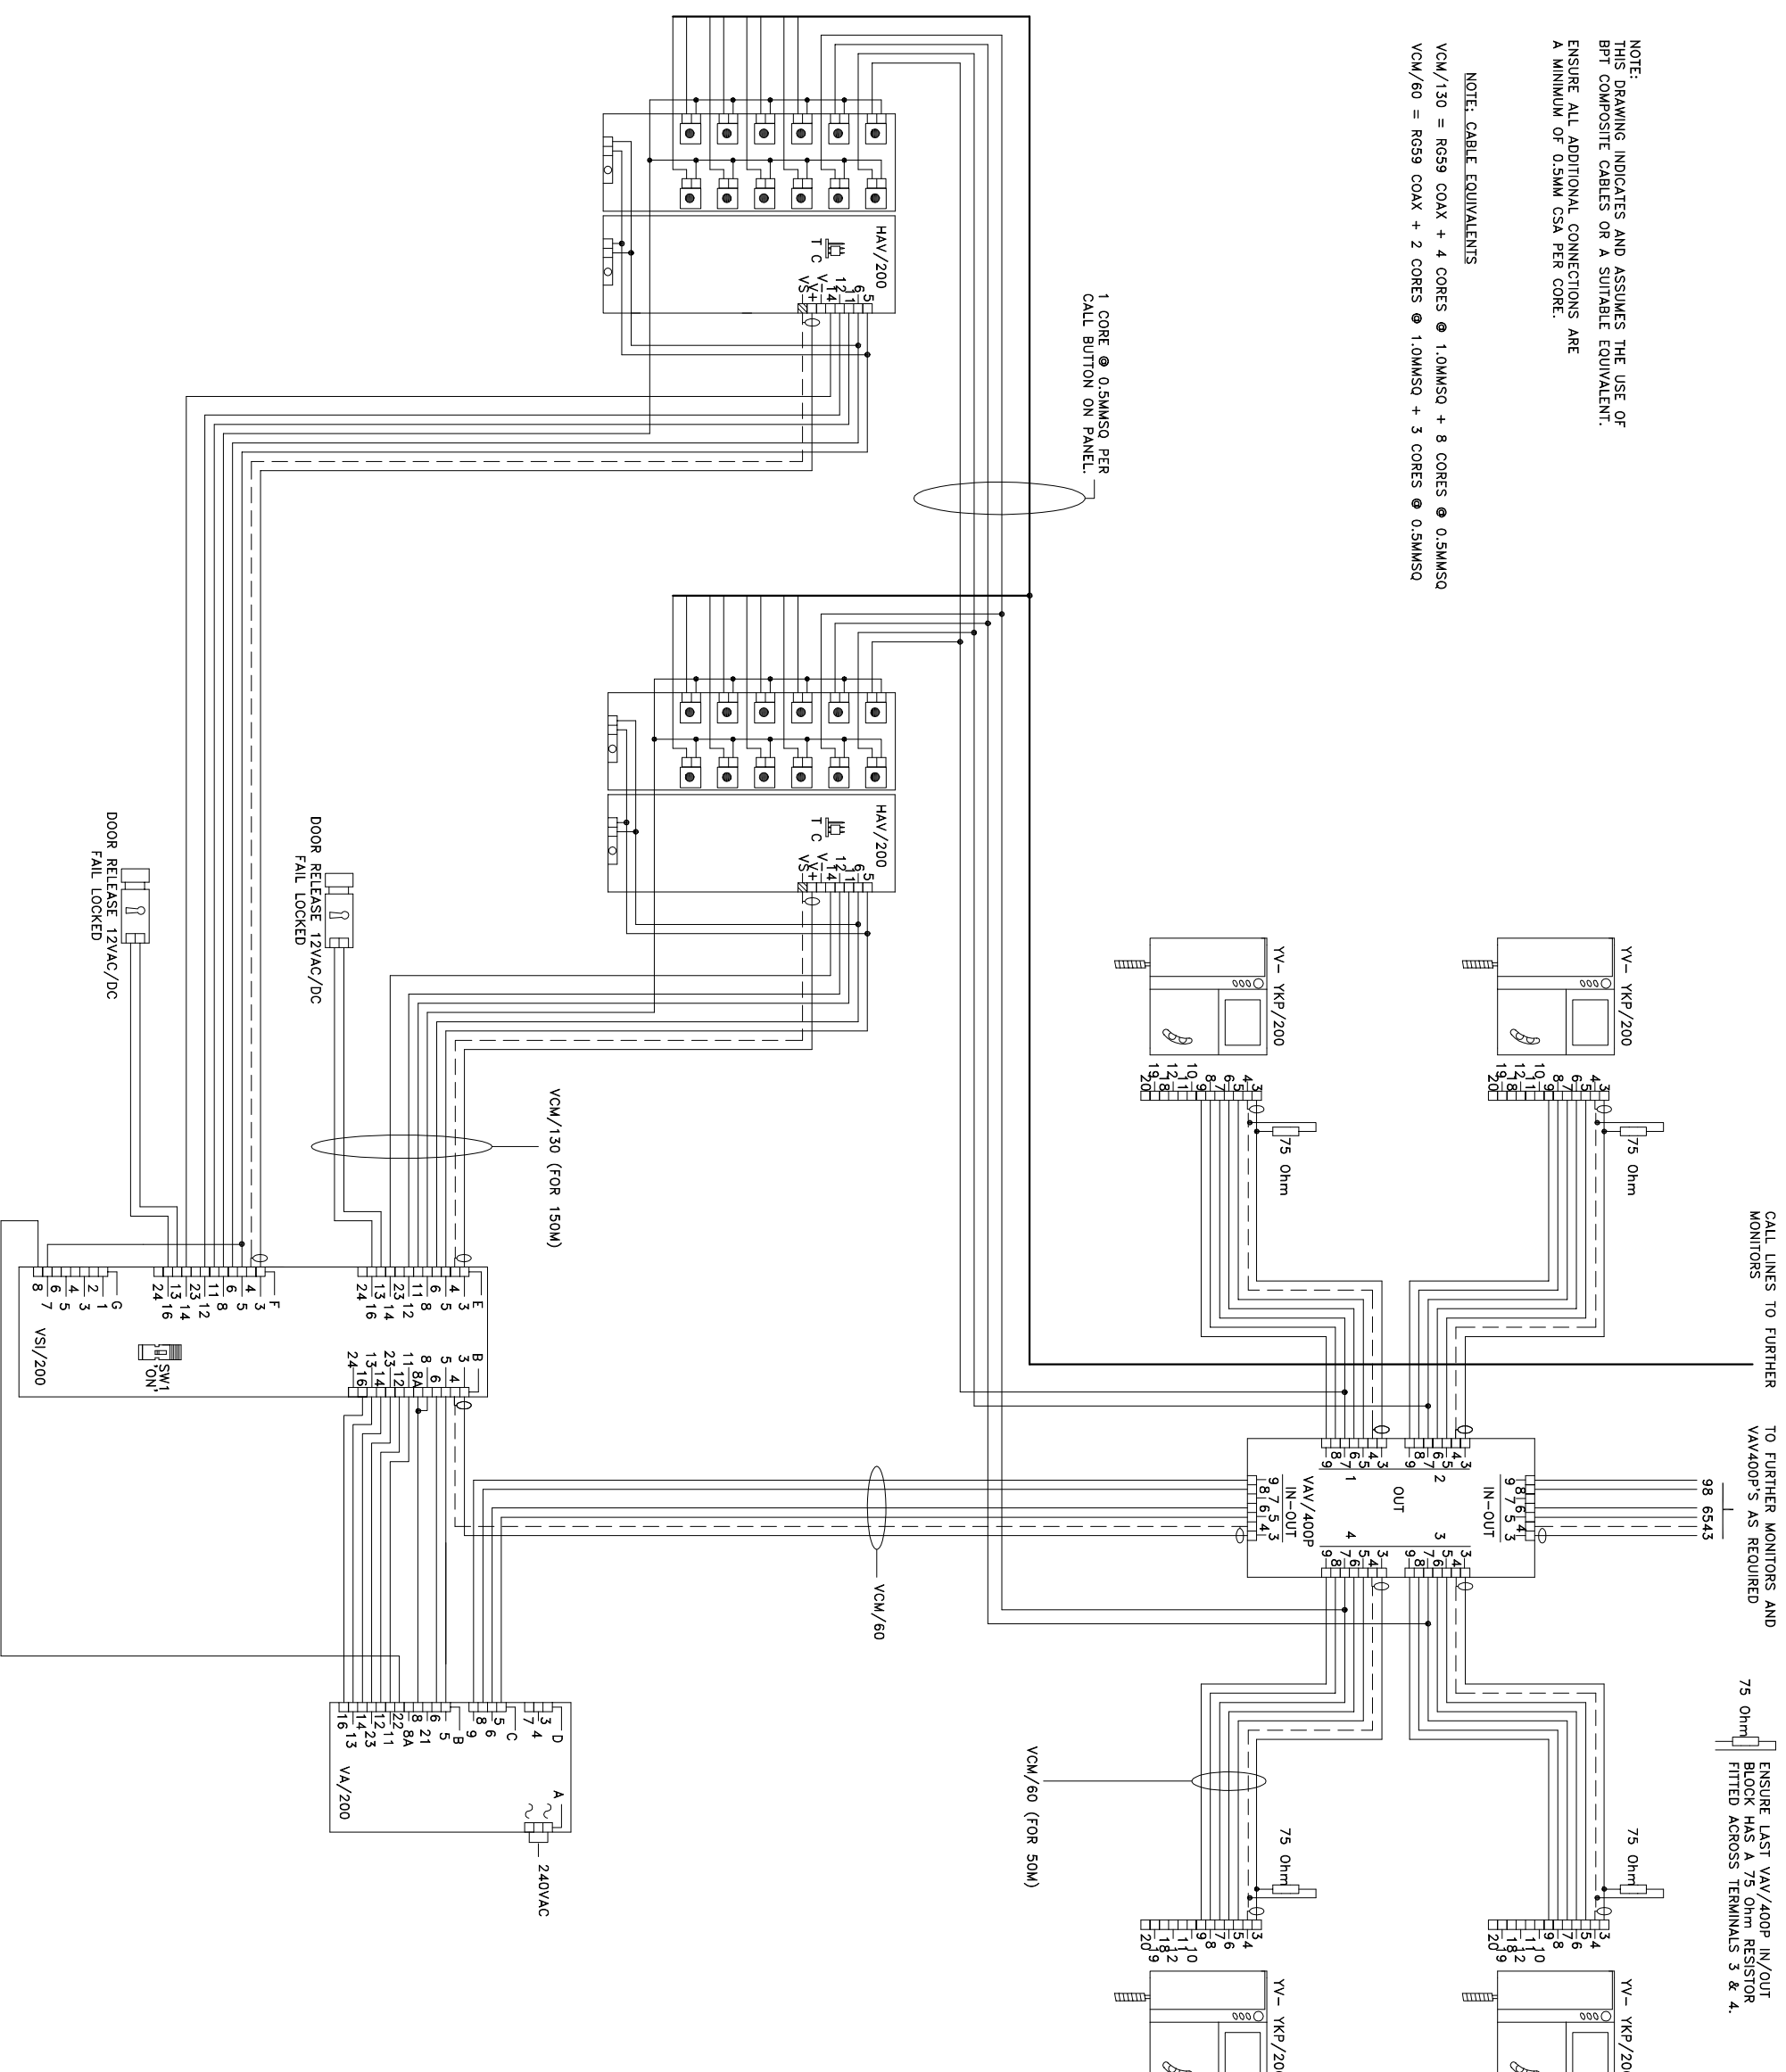

CALL LINES TO FURTHER
MONITORS

TO FURTHER MONITORS AND
VAV400P'S AS REQUIRED

75 Ohm
ENSURE LAST VAV/400P IN/OUT
BLOCK HAS A 75 Ohm RESISTOR
FITTED ACROSS TERMINALS 3 & 4.

1 CORE @ 0.5MMSQ PER
CALL BUTTON ON PANEL.

VCM/130 (FOR 150M)

VCM/60

VCM/60 (FOR 50M)

240VAC

DOOR RELEASE 12VAC/DC
FAIL LOCKED

DOOR RELEASE 12VAC/DC
FAIL LOCKED

BPT (UK) LTD. HERTS. ENGLAND	PREPARED FOR	
	INSTALLER INFORMATION	
DRAWING TITLE: 2 X MULTI-BUTTON TARGHA VIDEO ENTRY PANELS & LYNEA MONOCHROME MONITORS	DATE: 08/04/04	DRAWN:RC
	REVISED:	

DRAWING No.: B-NT2YNL(A)