


NOTE:
THIS DRAWING INDICATES AND ASSUMES THE USE OF
BPT COMPOSITE CABLES ON A SERVICEABLE EQUIPMENT.
ENSURE ALL ADDITIONAL CONNECTIONS ARE
A MINIMUM OF 0.5MM PER CORE.

NOTE: CABLE EQUIVALENTS
VCM/130 = RS9 COAX + 4 CORES ● 1.0MMSQ + 8 CORES ● 0.5MMSQ
VCM/80 = RS9 COAX + 2 CORES ● 1.0MMSQ + 3 CORES ● 0.5MMSQ

1 CORE ● 0.5MMSQ PER
CALL BUTTON ON PANEL

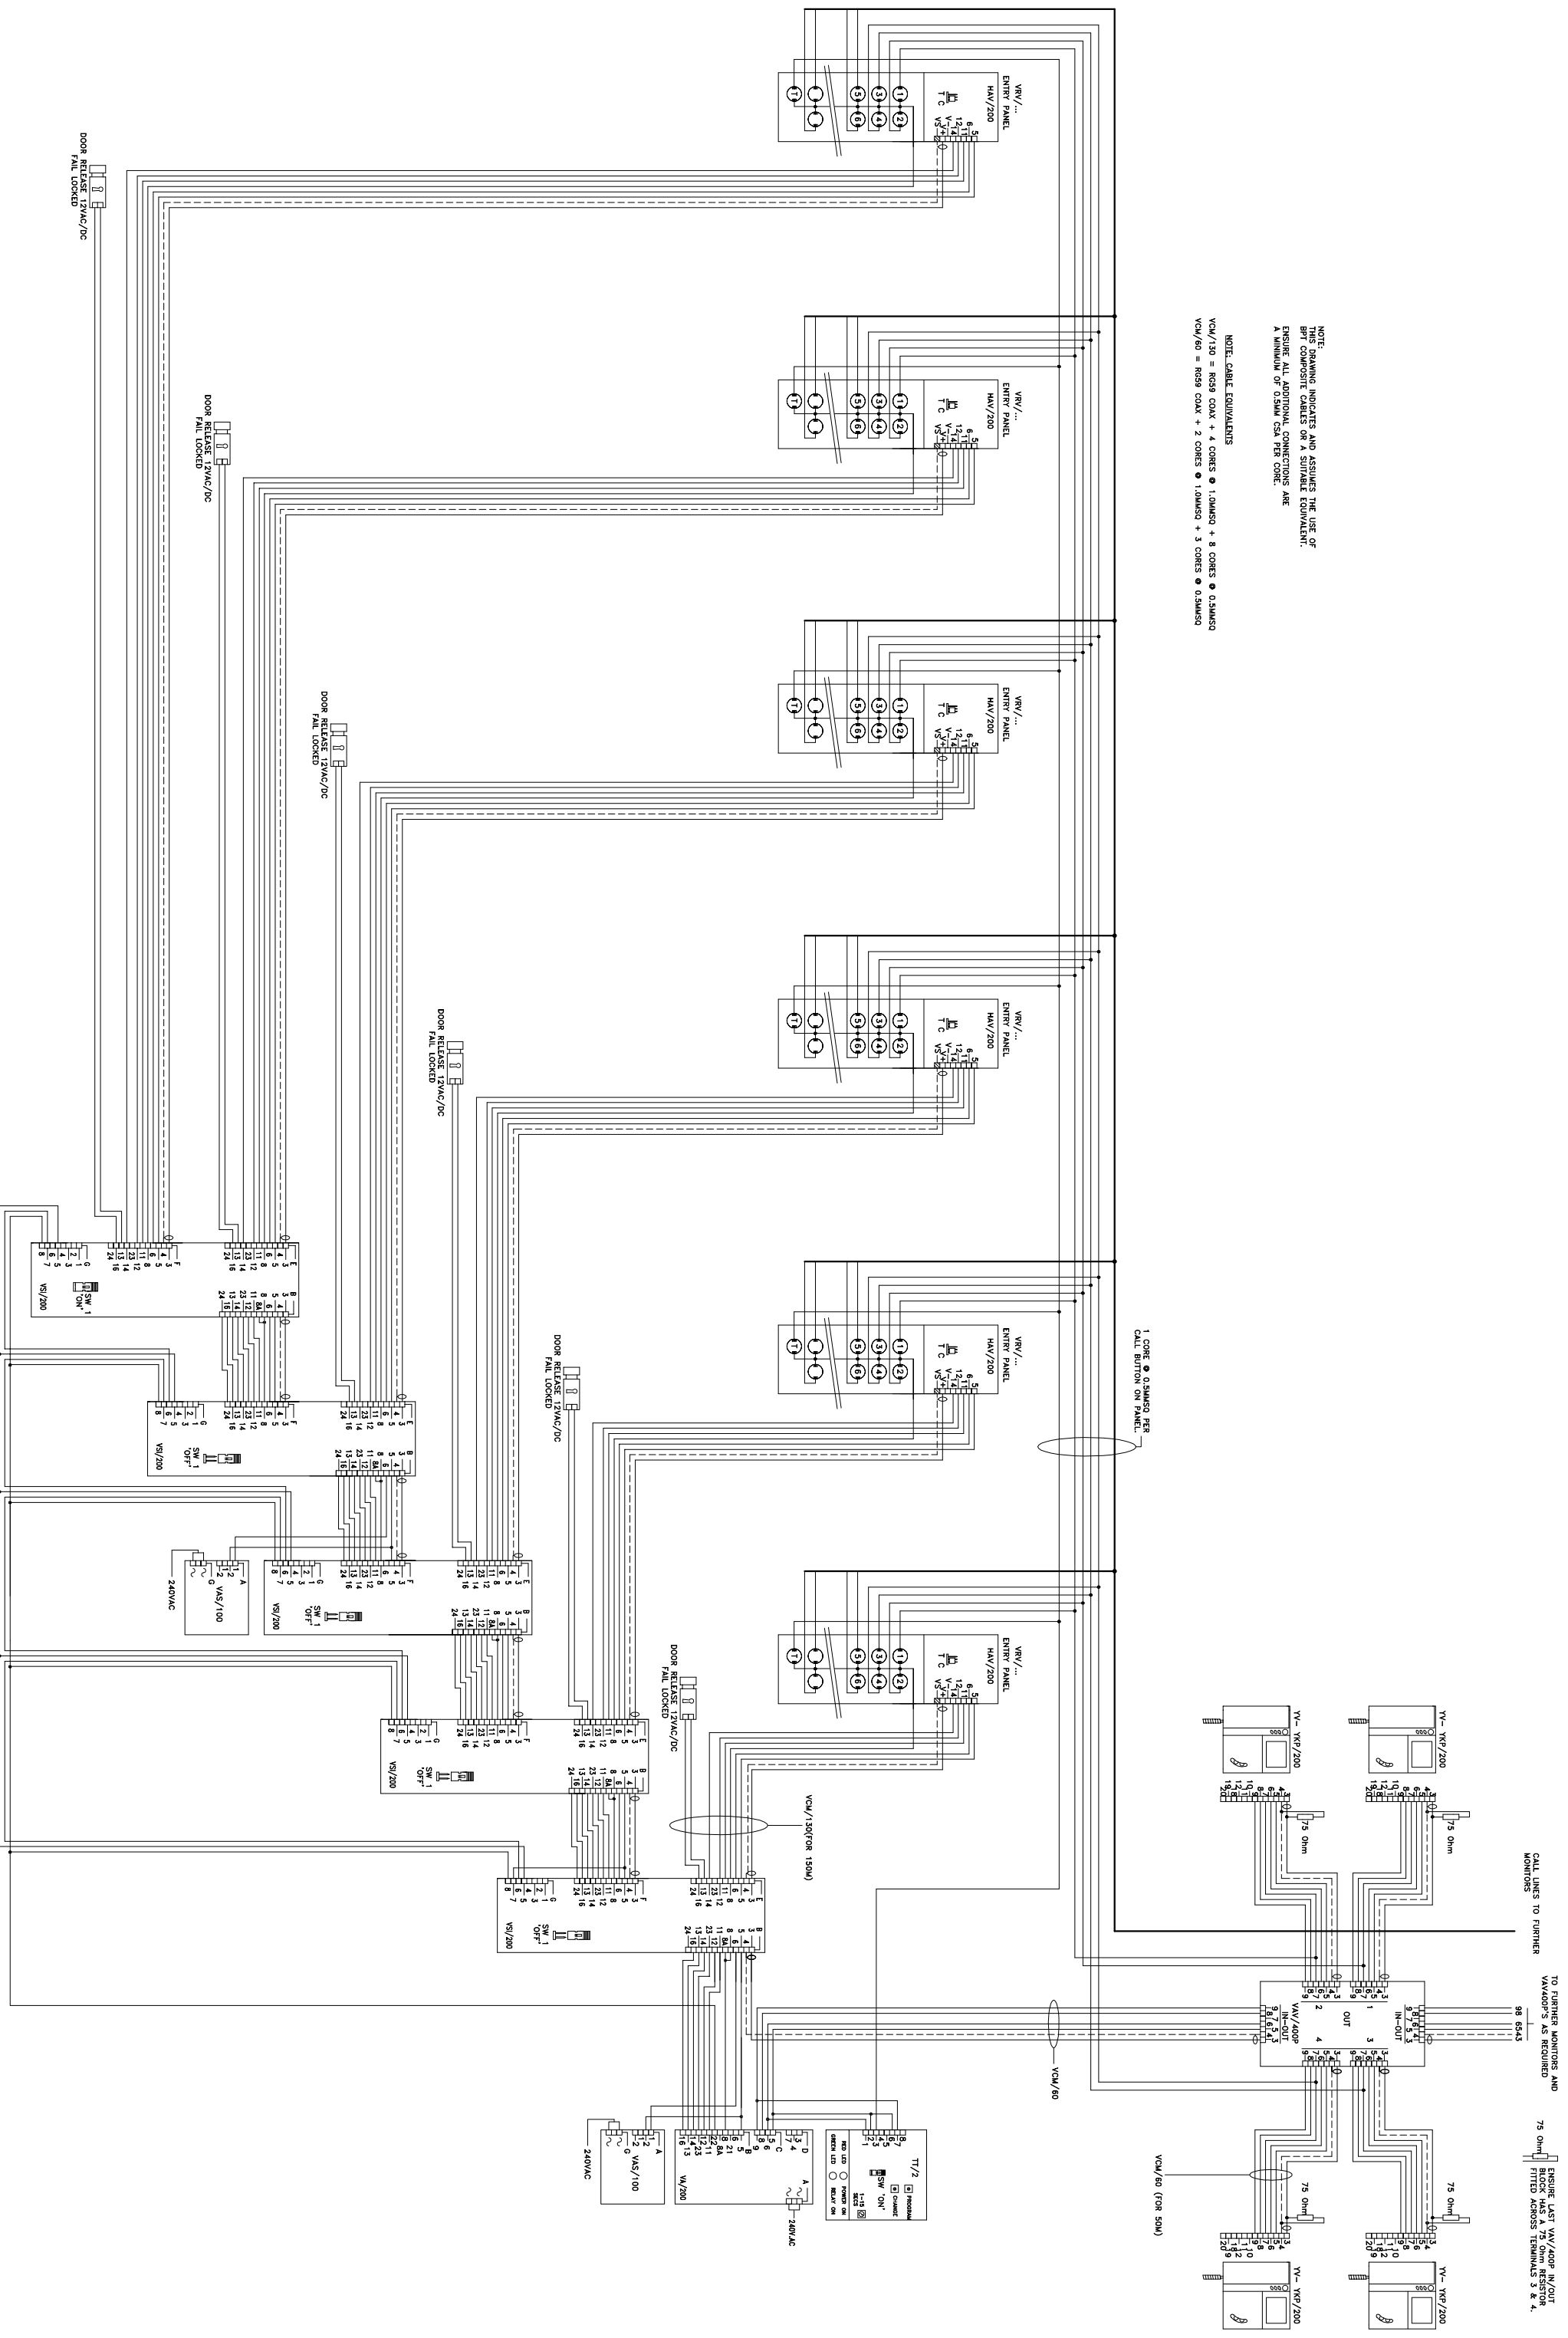

TO FURTHER MONITORS AND
VCM/80'S AS REQUIRED
98 65443
75 Ohm
ENSURE LAST VAV/400P IN/OUT
BLOCK HAS A 75 Ohm RESISTOR
FITTED ACROSS TERMINALS 3 & 4.

CALL LINES TO FURTHER
MONITORS

BPT (UK) LTD.
HERTS. ENGLAND
DRAWING NO: B-NV6VNLTT
DATE: 30/09/07
REVISED:
DRAWN:RC
PREPARED FOR
INSTALLER INFORMATION
MULTI-FLAT INSTALLATION USING 6 VANDAL RESISTANT
VIDEO ENTRY PANELS WITH TRADES & LYNEA MONITORS