


# REPROGRAMMING GUIDE

Engineers code	
Relay 1 code	
Relay 2 code	
Relay 3 code	

Relay 1 Time	
Relay 2 Time	
Relay 3 Time	

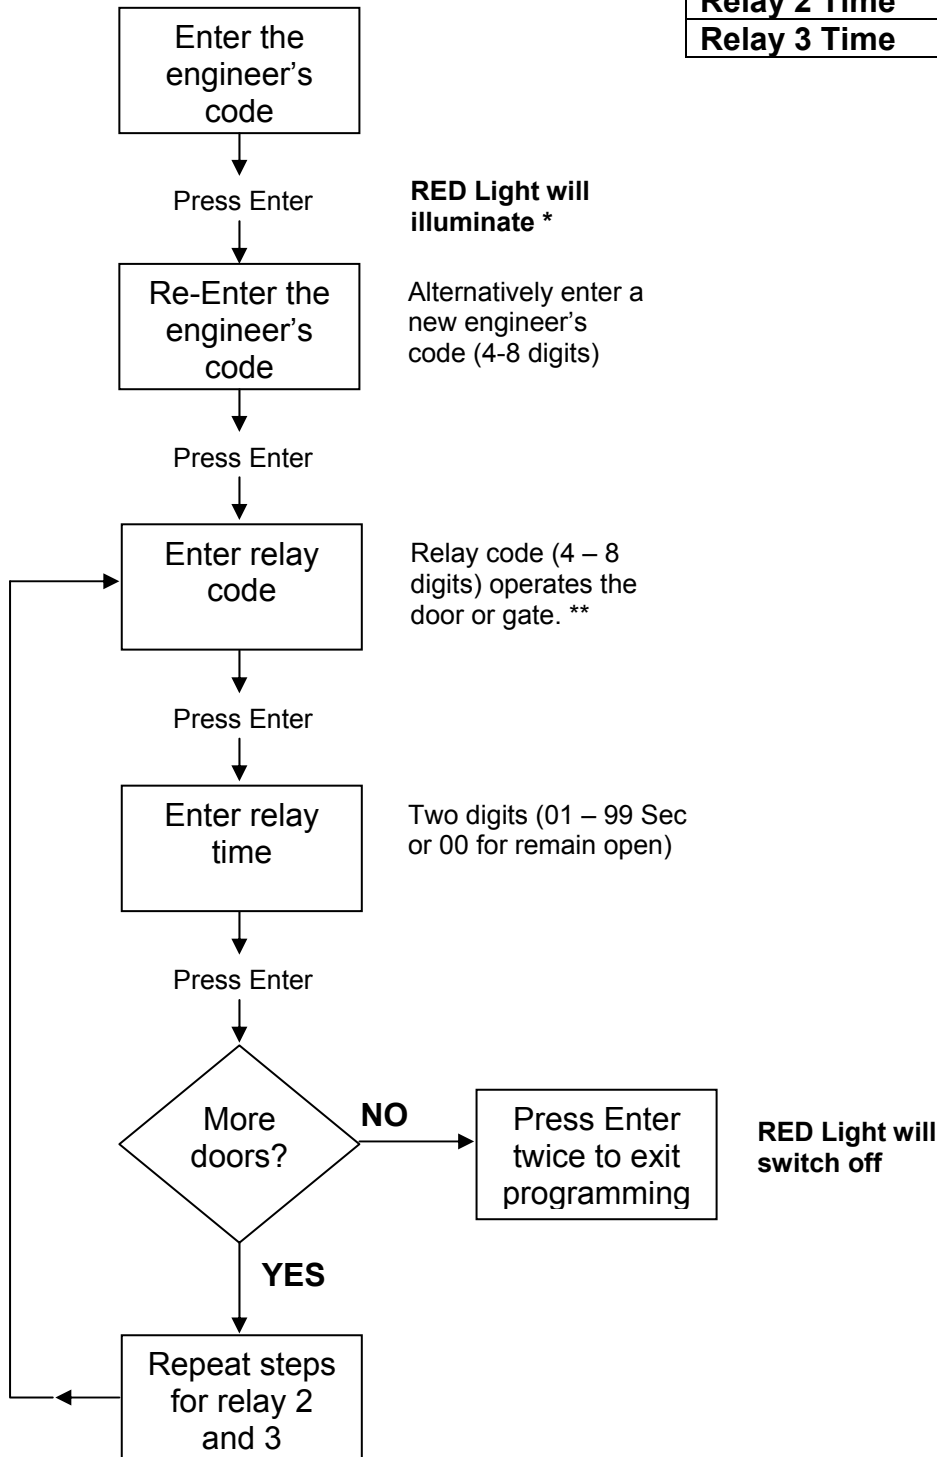

**Notes:**

\* If the red light does not illuminate, the engineers code is incorrect. Follow the factory default procedure below.

\*\* On the first loop of the flow chart its relay 1, second loop is relay 2 and the third loop is relay 3.

**FACTORY DEFAULT PROCEDURE**

Step 1 Remove the power from the keypad

Step 2 Press and hold the enter button while re-powering the keypad

Step 3 Release the enter button. The factory engineer's code is restored to 111111 (6 x 1)